


| : 243-204

MICRO PUSH WIRE® connector for junction boxes; for solid conductors; 0.8 mm Ø;
4-conductor; dark gray housing; light gray cover; Surrounding air temperature: max
60°C; 0,80 mm²; dark gray
<https://www.wago.com/243-204>



: ■ dark gray

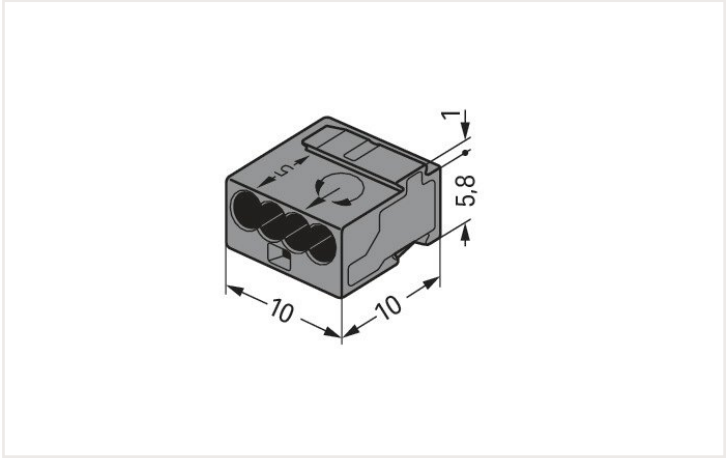

Dimensions in mm

Electrical data

Ratings per IEC/EN	
Ratings per	EN 60664
Nominal voltage (II/2)	100 V
Rated surge voltage (II/2)	1.5 kV
Rated current	6 A
Legend (ratings)	(II / 2) ≙ Overvoltage category II / Pollution degree 2

Connection data

Total number of connection points	4
Total number of potentials	1
Number of connection types	1
Number of levels	1

Connection 1	
Connection technology	PUSH WIRE®
Actuation type	Push-in
Connectable conductor materials	Copper
Solid conductor	22 ... 20 AWG
Conductor diameter	0.6 ... 0.8 mm / 22 ... 20 AWG
Conductor diameter (note)	When using conductors of the same diameter, 0.5 mm (24 AWG) or 1 mm (18 AWG) diameters are also possible.
Strip length	5 ... 6 mm / 0.2 ... 0.24 inches
Wiring direction	Side-entry wiring

Physical data	
Width	10 mm / 0.394 inches
Height	6.8 mm / 0.268 inches
Depth	10 mm / 0.394 inches

Material data	
Note (material data)	Information on material data can be found here
Color	dark gray
Cover color	light gray
Fire load	0.011 MJ
Weight	0.8 g

Environmental requirements	
Ambient temperature (operation)	+60 °C
Continuous operating temperature	105 °C


Commercial data	
eCl@ss 10.0	27-14-11-04
eCl@ss 9.0	27-14-11-04
ETIM 8.0	EC000446
ETIM 7.0	EC000446
PU (SPU)	1000 (100) Stück
Packaging type	Box
Country of origin VKOrg Germany	DE
GTIN	4044918440585
Customs tariff number VKOrg Germany	85369010000

Approvals and certificates			
Country specific Approvals			Ship Approvals
CCA CSA KEMA KEUR			ABS LR
CCA DEKRA Certification B.V.	EN 60998	NTR NL 7812	ABS American Bureau of Ship- ping
CSA DEKRA Certification B.V.	C22.2	70048857	LR Lloyds Register
KEMA/KEUR DEKRA Certification B.V.	EN 60998	71-112493	EN 60998
			04/20013 (E8)


UL-Approvals		
UL		
UR Underwriters Laboratories Inc.	UL 1059	E45172

Installation notes


Conductor termination



Strip solid conductors to 5 ... 6 mm (0.19 ... 0.23 inch).



Termination: Insert the stripped solid conductor until it hits the backstop.



Removal: Hold conductor to be removed and twist alternately left and right while pulling the connector.

Installation




Connector strips:
Assembling modular connectors into
connector strips.

Commoning



Commoned connector strips

Testing



Testing via test port opposite to conductor entry.



The 243 Series can be used in both communication and alarm systems according to the VdS (German Association of Property Insurers) guidelines.

No general approval is given to PUSH WIRE® connectors by the VdS association. The connectors must be tested together with the different parts of the system. The requirements for connectors are specified in the VdS guidelines for junction boxes (VdS 2116) in section 8.7: "The junction box connectors must be designed to guarantee a reliable and stable connection."

The verification of the fulfillment of these requirements is documented in the VDE test report No. 2574-1440-4031 for the insulated 243 Series PUSH WIRE® Connectors.